

**Review of Utility Company Request for New Conduit/Pole Location**

Applicant Information Project Address

Utility Gas  Electric  Telephone 160 Middlesex St

(circle one) Other Lowell, MA

Reason Installation of a new Heavy Duty HH

new building at 160 Middlesex St

Date Submitted Dec 4, 2019




Review done by John Gleason

Sidewalk Material	Concrete	<u>Asphalt</u>	Other
<b>Note: material to be replaced in kind (Concrete in full panels)</b>			
Sidewalk Vaults present	Y		<u>N</u>
Work on Street under a Paving Moratorium	<u>Y</u>		N
Is this location within the Flood Plain?	Y		<u>N</u>
Are ADA requirements being met?	<u>Y</u>		N

Comments

1. Contractor shall notify abutters at least 72 hours prior to beginning work.
2. South St is under paving moratorium (paved in 2018), restoration is to be coordinated with developer of 160 Middlesex St. and City Engineer's Office. *Curb to Curb restoration, plus any impacted sidewalks will be required*

Outcome of Review

Approved 	Approved With Comments 	Denied 
---	--	---

Christine Clancy, P.E.  
 City Engineer

*Christine Clancy*

---

**nationalgrid**

November 27, 2019

**The City Council of Lowell, Massachusetts**

**To Whom It May Concern:**

Enclosed please find a petition of NATIONAL GRID covering the installation of underground facilities.

If you have any questions regarding this permit, please contact:

**Michael Meneades 978-725-1033**

If this petition meets with your approval, please return an executed copy to:

National Grid: Lisa Ayres; 1101 Turnpike Street; North Andover, MA 01845; # 978-725-1418

Very truly yours,

*Dave Johnson/lla*

Dave Johnson  
Supervisor, Distribution Design

Enclosures

NOV 28 2019 10:10 AM

DEC 4 19 PM 12:55  
COMMERS

Questions contact -- Michael Meneades 978-725-1033

Petition of the Massachusetts Electric Company d/b/a NATIONAL GRID  
OF NORTH ANDOVER, MASSACHUSETTS  
For Electric Conduit Location:

To the City Council of Lowell, Massachusetts

Respectfully represents the Massachusetts Electric Company d/b/a NATIONAL GRID of North Andover, Massachusetts, that it desires to construct a line of underground electric conduits, including the necessary sustaining and protecting fixtures, under and across the public way or ways hereinafter named.

Wherefore it prays that after due notice and hearing as provided by law, it be granted permission to excavate the public highways and to run and maintain underground electric conduits, together with such sustaining and protecting fixtures as it may find necessary for the transmission of electricity, said underground conduits to be located substantially in accordance with the plan filed herewith marked -- South St. - Lowell, Massachusetts.

The following are the streets and highways referred to:

28890722 South St. - Beginning at a point approximately 95 feet south of the centerline of the intersection of Middlesex St. and South St. customer to install 25 +/- feet of 2-4 inch conduit and a heavy duty HH on South St. to feed new building at 160 Middlesex St., Lowell.

Location approximately as shown on plan attached.

Massachusetts Electric Company d/b/a  
NATIONAL GRID  
BY \_\_\_\_\_  
Engineering Department

*Dave Johnson/lla*

Dated: November 27, 2019

ORDERED:

Notice having been given and public hearing held, as provided by law, that the Massachusetts Electric Company d/b/a NATIONAL GRID be and it is hereby granted permission to excavate the public highways and to run and maintain underground electric conduits, together with such sustaining and protecting fixtures as said company may deem necessary, in the public way or ways hereinafter referred to, and to make the necessary house connections along said extensions, as requested in petition with said company dated the 27th day of November 2019.

Said underground electric conduits shall be located substantially in accordance with the plan filed herewith marked -South St. - Lowell, Massachusetts.

The following are the public ways or part of ways along which the underground electric conduits above referred to may be laid:

28890722 South St. - Beginning at a point approximately 95 feet south of the centerline of the intersection of Middlesex St. and South St. customer to install 25 +/- feet of 2-4 inch conduit and a heavy duty HH on South St. to feed new building at 160 Middlesex St., Lowell.

I hereby certify that the foregoing order was adopted at a meeting of the .....  
....., held on the ..... day of ....., 20 .....  
....., 20 .....

Received and entered in the records of location orders of the City/Town of  
Book ..... Page .....

Attest:  
.....

..... hereby certify that on .....20....., at ..... o'clock, ....M  
at ....., a public hearing was held on the petition of  
Massachusetts Electric Company d/b/a NATIONAL GRID for permission to construct the  
underground electric conduits described in the order herewith recorded, and that I mailed at least  
seven days before said hearing a written notice of the time and place of said hearing to each of the  
owners of real estate (as determined by the last preceding assessment for taxation) along the ways  
or parts of ways upon which the Company is permitted to construct the underground electric  
conduits under said order. And that thereupon said order was duly adopted.

.....  
.....  
.....

ORDERED:

Notice having been given and public hearing held, as provided by law, that the Massachusetts Electric Company d/b/a NATIONAL GRID be and it is hereby granted permission to excavate the public highways and to run and maintain underground electric conduits, together with such sustaining and protecting fixtures as said company may deem necessary, in the public way or ways hereinafter referred to, and to make the necessary house connections along said extensions, as requested in petition with said company dated the 27th day of November 2019.

Said underground electric conduits shall be located substantially in accordance with the plan filed herewith marked -South St. - Lowell, Massachusetts.

The following are the public ways or part of ways along which the underground electric conduits above referred to may be laid:

28890722 South St. - Beginning at a point approximately 95 feet south of the centerline of the intersection of Middlesex St. and South St. customer to install 25 +/- feet of 2-4 inch conduit and a heavy duty HH on South St. to feed new building at 160 Middlesex St., Lowell.

I hereby certify that the foregoing order was adopted at a meeting of the .....  
....., held on the ..... day of ....., 20 .....

....., ..... 20 .....

Received and entered in the records of location orders of the City/Town of  
Book ..... Page .....

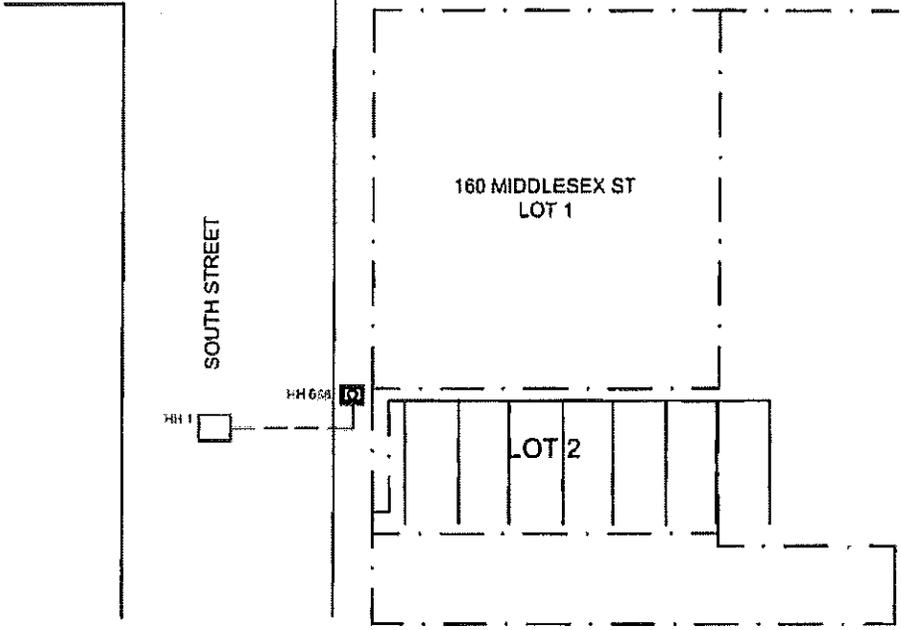
Attest:  
.....

..... hereby certify that on .....20....., at ..... o'clock, ....M  
at ....., a public hearing was held on the petition of  
Massachusetts Electric Company d/b/a NATIONAL GRID for permission to construct the  
underground electric conduits described in the order herewith recorded, and that I mailed at least  
seven days before said hearing a written notice of the time and place of said hearing to each of the  
owners of real estate (as determined by the last preceding assessment for taxation) along the ways  
or parts of ways upon which the Company is permitted to construct the underground electric  
conduits under said order. And that thereupon said order was duly adopted.

.....  
.....  
.....



MIDDLESEX STREET



160 MIDDLESEX ST  
LOT 1

SOUTH STREET

LOT 2



WR# 28890722

**UNDERGROUND PETITION**

**nationalgrid**

MANHOLE (EXISTING)    PROPOSED CONDUIT 2-4"

HEAVY DUTY HANDHOLE (PROPOSED)

Date: 11/26/2019

Customer will install 2-4" conduit from existing MH 1 on South St, to new heavy duty handhole in the sidewalk. This will be used to provide power to 160 Middlesex St

WORK REQUEST: 28890722

To The: City                      Of Lowell

For Proposed: Conduit and handhole                      Location: South Street

Drawn By: M. Meneades

DISTANCES ARE APPROXIMATE