

**CITY OF LOWELL**

**PETITION**

**CITY COUNCIL  
Conduit Location**

Paternal Blvd

Utility relocation for  
Bridgeway Place in City of Lowell  
for the purpose of providing  
water service

In City Council

July 24, 2018

Read and hearing ordered for 7PM on

August 1, 2018

**Read, Hearing Held,  
Referred to Wire In-  
spector, Development  
Services**

City Clerk

## Review of Utility Company Request for New Conduit/Pole Location

Applicant Information

Utility Gas **Electric** Telephone

(circle one) Other

Reason Utility Relocation for Bridge Replacement

Project Address

Pawtucket St over Pawtucket Canal

Lowell, MA

Date Submitted 7/10/2018

Review done by Richard Biagini

Sidewalk Material

Note: material to be replaced in kind (Concrete in full panels)

**Concrete** Asphalt Other

Sidewalk Vaults present Y (N)

Work on Street under a Paving Moratorium Y (N)

Is this location within the Flood Plain? Y (N)

Are ADA requirements being met? (Y) N

Comments

Outcome of Review

Approved

Approved With  
Comments

Denied

X

James Donison, P.E.  
 Commissioner of Public Works

*r/bi*

---

Questions contact – Anne Murray 508 935 1812 Revision

2018 JUN 18 AM 10: 01  
CITY OF LOWELL  
CITY CLERK'S OFFICE

Petition of the NATIONAL GRID  
Of NORTH ANDOVER, MASSACHUSETTS  
For Electric conduit Location:

To the City Council of Lowell Massachusetts

Respectfully represents the NATIONAL GRID of North Andover, Massachusetts, that it desires to construct a line of underground electric conduits, including the necessary sustaining and protecting fixtures, under and across the public way or ways hereinafter named.

Wherefore it prays that after due notice and hearing as provided by law, it be granted permission to excavate the public highways and to run and maintain underground electric conduits, together with such sustaining and protecting fixtures as it may find necessary for the transmission of electricity, said underground conduits to be located substantially in accordance with the plan filed herewith marked – Pawtucket St-Lowell Massachusetts

The following are the streets and highways referred to:

23620502 Pawtucket St-National Grid to install new manhole on west side of bridge approximately 15 feet from bridge approach, and install approximately 5 feet of 4-5” conduit from new manhole to connect to conduit installed by bridge contractor. We will also install approximately 100 feet of 4-5” conduit encased in concrete from pole 50 on west side of Pawtucket St Bridge over Pawtucket canal to new manhole. National Grid also to remove pole 49, relocate pole 48 10 feet west of pole 47 .Also we will install approximately 100 feet of 4-5” conduit encased in concrete from pole 47 on east side of Pawtucket St Bridge over Pawtucket Canal at 10 feet from bridge approach. See attachments for detailed information.

Location approximately as shown on plan attached

NATIONAL GRID  
BY     Dan Tolson      
Engineering Department



City

Dated: June 14, 2018

ORDERED:

Notice having been given and public hearing held, as provided by law, that the NATIONAL GRID be and it is hereby granted permission to excavate the public highways and to run and maintain underground electric conduits, together with such sustaining and protecting fixtures as said company may deem necessary, in the public way or ways hereinafter referred to, and to make the necessary house connections along said extensions, as requested in petition with said company dated the 14<sup>th</sup> day of June 2018.

Said underground electric conduits shall be located substantially in accordance with the plan filed herewith marked –Pawtucket St-Lowell Massachusetts

The following are the public ways or part of ways along which the underground electric conduits above referred to may be laid:

**23620502** Pawtucket St-National Grid to install new manhole on west side of bridge approximately 15 feet from bridge approach, and install approximately 5 feet of 4-5” conduit from new manhole to connect to conduit installed by bridge contractor. We will also install approximately 100 feet of 4-5” conduit encased in concrete from pole 50 on west side of Pawtucket St Bridge over Pawtucket canal to new manhole. National Grid also to remove pole 49, relocate pole 48 10 feet west of pole 47 .Also we will install approximately 100 feet of 4-5” conduit encased in concrete from pole 47 on east side of Pawtucket St Bridge over Pawtucket Canal at 10 feet from bridge approach. See attachments for detailed information.

I hereby certify that the foregoing order was adopted at a meeting of the .....  
.....  
....., held on the ..... day of ....., 20 .....  
....., ..... 20 .....

Received and entered in the records of location orders of the City/Town of  
Book ..... Page .....

Attest:

.....

..... hereby certify that on .....20....., at ..... o'clock, ....M  
at ....., a public hearing was held on the petition of  
NATIONAL GRID for permission to construct the underground electric conduits described in the  
order herewith recorded, and that I mailed at least seven days before said hearing a written notice  
of the time and place of said hearing to each of the owners of real estate (as determined by the last  
preceding assessment for taxation) along the ways or parts of ways upon which the Company is  
permitted to construct the underground electric conduits under said order. And that thereupon said  
order was duly adopted.

.....  
.....  
.....

Dated: June 14, 2018

ORDERED:

Notice having been given and public hearing held, as provided by law, that the NATIONAL GRID be and it is hereby granted permission to excavate the public highways and to run and maintain underground electric conduits, together with such sustaining and protecting fixtures as said company may deem necessary, in the public way or ways hereinafter referred to, and to make the necessary house connections along said extensions, as requested in petition with said company dated the 14<sup>th</sup> day of June 2018.

Said underground electric conduits shall be located substantially in accordance with the plan filed herewith marked –Pawtucket St-Lowell Massachusetts

The following are the public ways or part of ways along which the underground electric conduits above referred to may be laid:

**23620502** Pawtucket St-National Grid to install new manhole on west side of bridge approximately 15 feet from bridge approach, and install approximately 5 feet of 4-5” conduit from new manhole to connect to conduit installed by bridge contractor. We will also install approximately 100 feet of 4-5” conduit encased in concrete from pole 50 on west side of Pawtucket St Bridge over Pawtucket canal to new manhole. National Grid also to remove pole 49, relocate pole 48 10 feet west of pole 47 .Also we will install approximately 100 feet of 4-5” conduit encased in concrete from pole 47 on east side of Pawtucket St Bridge over Pawtucket Canal at 10 feet from bridge approach. See attachments for detailed information.

I hereby certify that the foregoing order was adopted at a meeting of the .....  
.....  
....., held on the ..... day of ....., 20 .....  
....., 20 .....

Received and entered in the records of location orders of the City/Town of  
Book ..... Page .....

Attest:

.....

..... hereby certify that on .....20....., at ..... o'clock, ....M at ....., a public hearing was held on the petition of NATIONAL GRID for permission to construct the underground electric conduits described in the order herewith recorded, and that I mailed at least seven days before said hearing a written notice of the time and place of said hearing to each of the owners of real estate (as determined by the last preceding assessment for taxation) along the ways or parts of ways upon which the Company is permitted to construct the underground electric conduits under said order. And that thereupon said order was duly adopted.

.....  
.....  
.....

Dated: June 14, 2018

ORDERED:

Notice having been given and public hearing held, as provided by law, that the NATIONAL GRID be and it is hereby granted permission to excavate the public highways and to run and maintain underground electric conduits, together with such sustaining and protecting fixtures as said company may deem necessary, in the public way or ways hereinafter referred to, and to make the necessary house connections along said extensions, as requested in petition with said company dated the 14<sup>th</sup> day of June 2018.

Said underground electric conduits shall be located substantially in accordance with the plan filed herewith marked –Pawtucket St-Lowell Massachusetts

The following are the public ways or part of ways along which the underground electric conduits above referred to may be laid:

**23620502** Pawtucket St-National Grid to install new manhole on west side of bridge approximately 15 feet from bridge approach, and install approximately 5 feet of 4-5” conduit from new manhole to connect to conduit installed by bridge contractor. We will also install approximately 100 feet of 4-5” conduit encased in concrete from pole 50 on west side of Pawtucket St Bridge over Pawtucket canal to new manhole. National Grid also to remove pole 49, relocate pole 48 10 feet west of pole 47 .Also we will install approximately 100 feet of 4-5” conduit encased in concrete from pole 47 on east side of Pawtucket St Bridge over Pawtucket Canal at 10 feet from bridge approach. See attachments for detailed information.

I hereby certify that the foregoing order was adopted at a meeting of the .....  
.....  
....., held on the ..... day of ....., 20 .....  
....., ..... 20 .....

Received and entered in the records of location orders of the City/Town of  
Book ..... Page .....

Attest:




.....

..... hereby certify that on .....20....., at ..... o'clock, ....M at ....., a public hearing was held on the petition of NATIONAL GRID for permission to construct the underground electric conduits described in the order herewith recorded, and that I mailed at least seven days before said hearing a written notice of the time and place of said hearing to each of the owners of real estate (as determined by the last preceding assessment for taxation) along the ways or parts of ways upon which the Company is permitted to construct the underground electric conduits under said order. And that thereupon said order was duly adopted.

.....  
.....  
.....

# 23620502 Revised 6/14/18

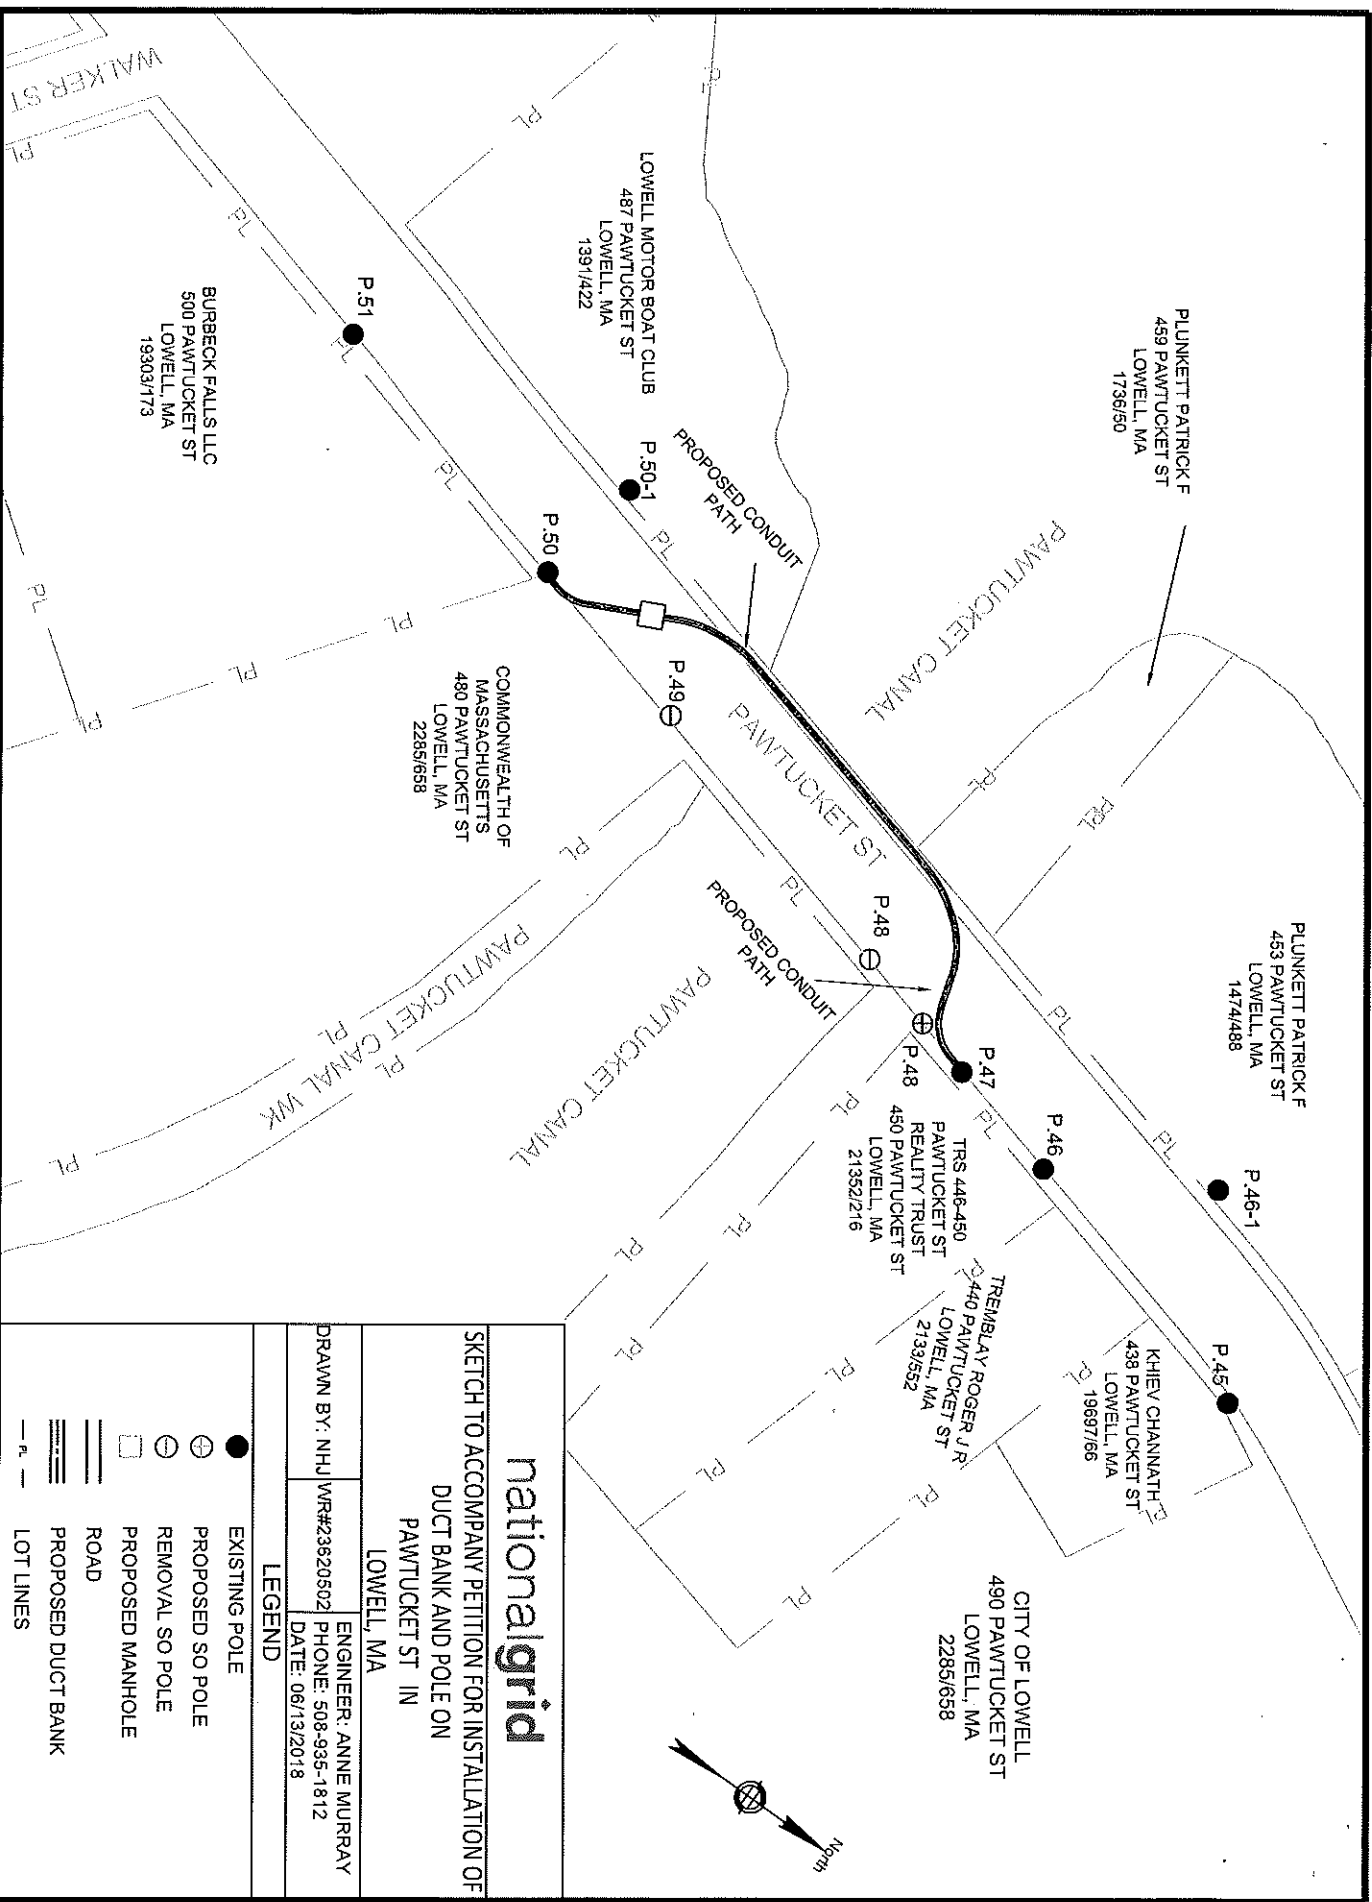

**nationalgrid**

SKETCH TO ACCOMPANY PETITION FOR INSTALLATION OF  
DUCT BANK AND POLE ON  
PAWTUCKET ST IN  
LOWELL, MA

ENGINEER: ANNE MURRAY  
PHONE: 508-935-1812  
DATE: 06/13/2018

DRAWN BY: NHJ WFR#23620502

LEGEND	
	EXISTING POLE
	PROPOSED SO POLE
	REMOVAL SO POLE
	PROPOSED MANHOLE
	ROAD
	PROPOSED DUCT BANK
	LOT LINES